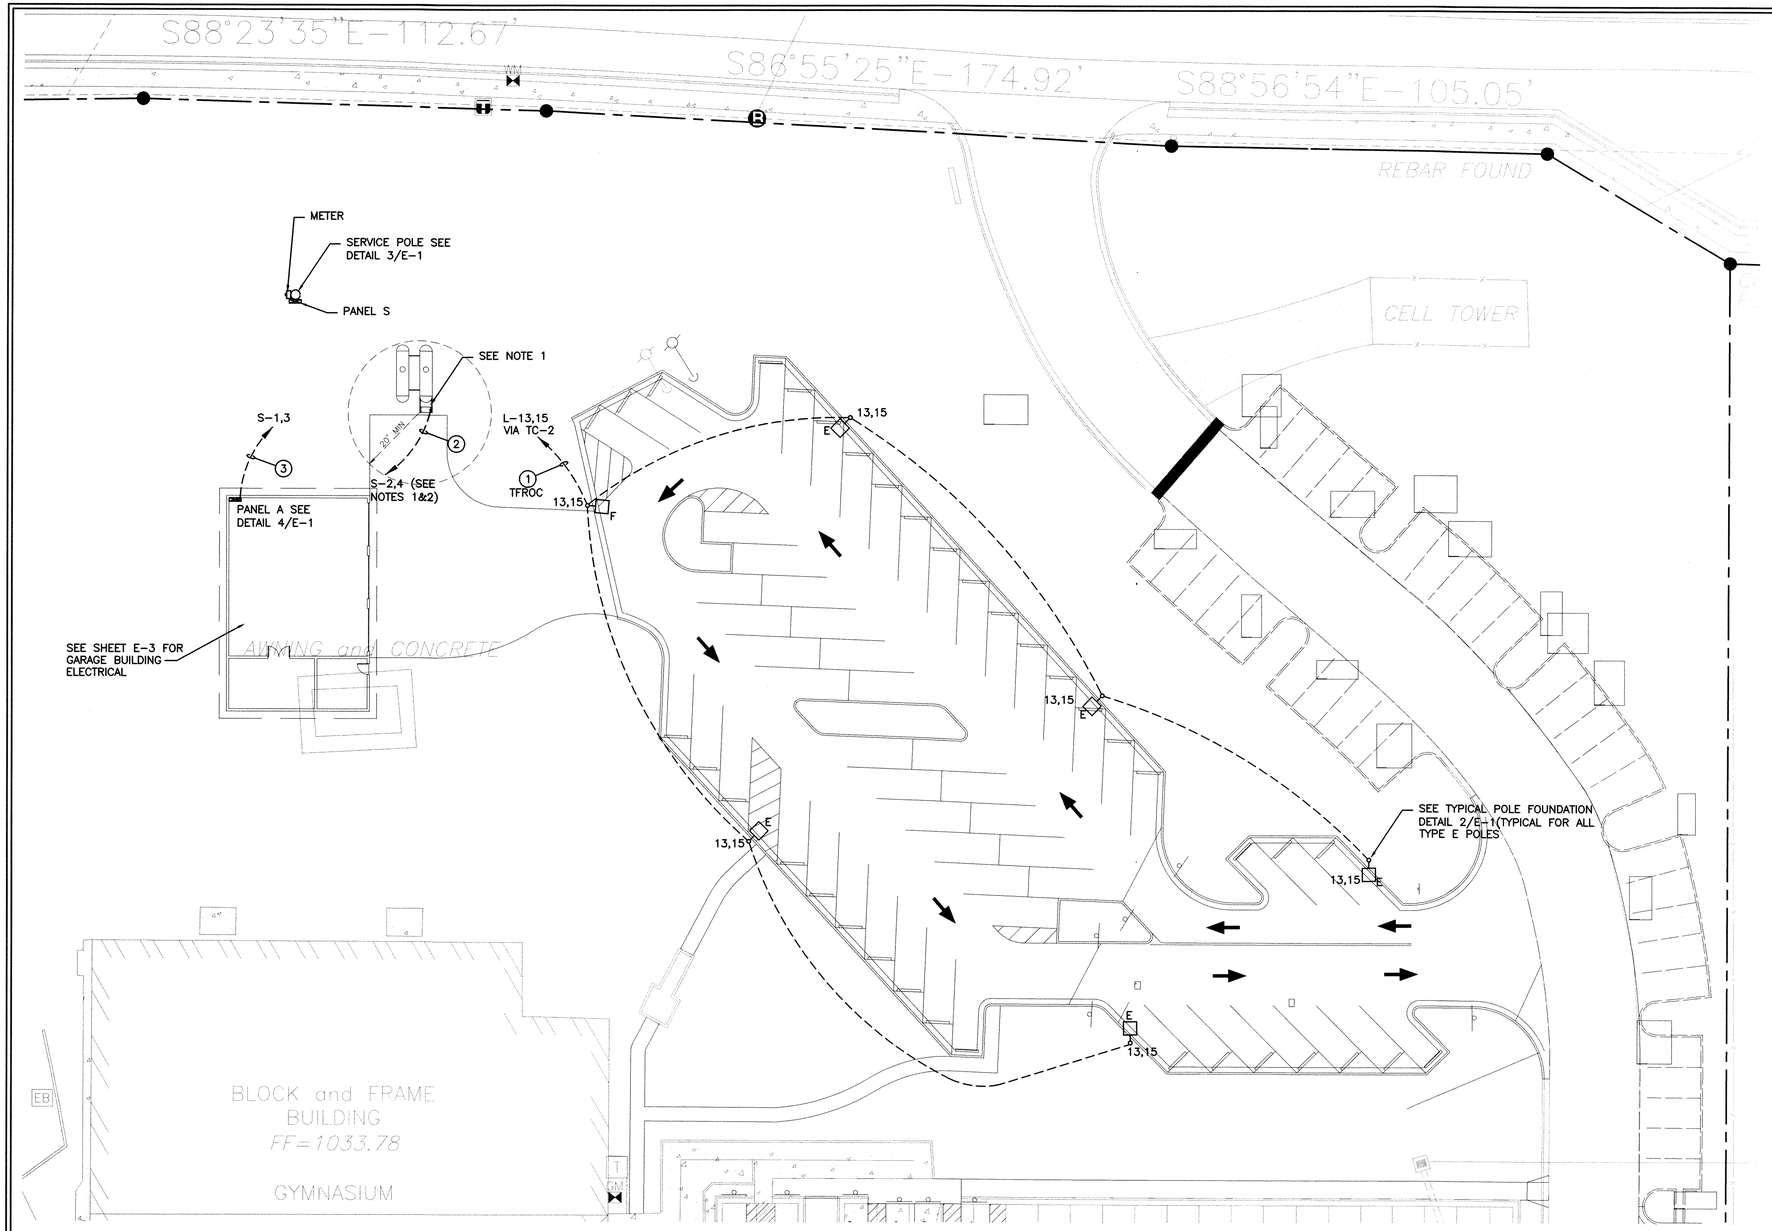

1 / E-2 SITE LIGHTING PLAN

SCALE: 1"=20'-0"

WIRING SCHEDULE

1. 2#10 + 1#10G IN 3/4 C.
2. 3#8 + 1#8G IN 1" C.
3. 3#3/0 + 1#4G IN 2" C.

ALL CONDUCTORS ARE TO BE COPPER

NOTES

1. CONTRACTOR TO PROVIDE AND INSTALL EXPLOSION PROOF CONDUIT SEAL OFF FITTING AT EACH END OF THE CONDUIT. ONCE THE CONDUCTORS ARE INSTALLED AND TESTED, POUR EACH SEAL AS REQUIRED. PAINT THE OPENING CAP RED TO DENOTE THE SEAL IS POURED.
2. RUN RGS CONDUIT FROM THE LAST 90° BEND TO UP INTO THE DISPENSER. INSTALL CONDUIT SEALOFF FILLING INSIDE THE DISPENSER WHERE THE CONDUIT ENTERS ABOVE GRADE.

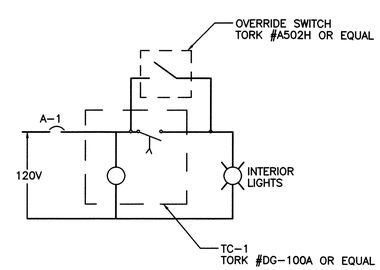

2 / E-2 TC-1 SCHEMATIC

SCALE: NTS

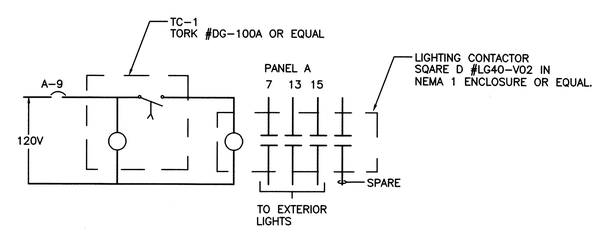

3 / E-2 TC-2 SCHEMATIC

SCALE: NTS

WOMACK & ASSOCIATES
CONSULTING ENGINEERS
2300 Lake Park Dr, Suite 250
Smyrna, Georgia 30080
Voice: 770-458-3005
Fax: 770-458-8388

Womack & Associates, 2014. This drawing may be utilized only for the purpose of constructing or installing the work shown thereon at the site of the work specified. Any other use of this drawing, including without limitation any reproduction or alteration of this drawing, without the prior written approval of Womack & Associates is prohibited.

REVISIONS		
ACTION	DATE	DESCRIPTION

ELECTRICAL SITE PLAN

HAMMOND PARK RENOVATION
705 HAMMOND DRIVE AT GLENRIDGE
SANDY SPRINGS, GA 30328

CITY OF SANDY SPRINGS
7840 ROSWELL RD
BUILDING 500
SANDY SPRINGS, GA 30350

GEORGIA REGISTERED 1956 PROFESSIONAL ENGINEER
06.12.2014

DRAWN: AAP	SCALE: AS SHOWN
CHECKED: WMW	DATE: 06.12.2014
14036 W&A JOB NO.	E-2 DRAWING NUMBER